
CWSD Freeze Proof Hydrant

Installation Requirements

A Dual Check, <u>not</u> a double check, shall be installed anywhere in a customer's service line, after the shutoff valve and before the bury hydrant. Preferably in an accessible location for future maintenance and replacement.

Multiple hydrants require one in line before all hydrants or one at each hydrant.

These are required whether the hydrant is temporary or permanent.

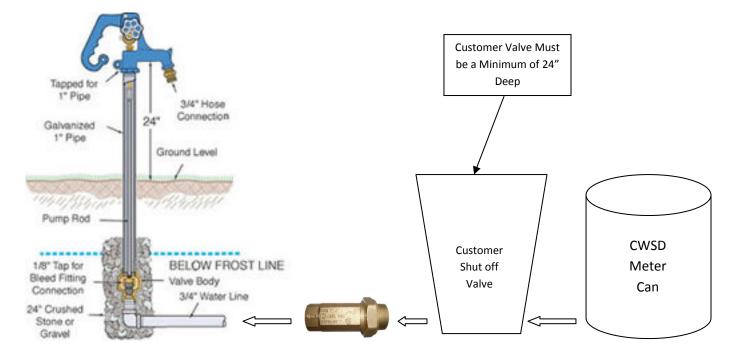

Dual Check assemblies are manufactured by many different companies. Below is just for example purposes.



Revision Date: 07/12/12